

Commercial Scale Reduction Units


Stainless Steel FOS Models

Package includes:

- Stainless Steel Housing
- 4 filters 20" with media inside
- 4 stems 4" approximate length

After plumbing the unit and securing it to the foundation and ensuring required straps for earthquake compliance, proceed as follows:



- 1) Remove top of stainless steel housing at the wing nut

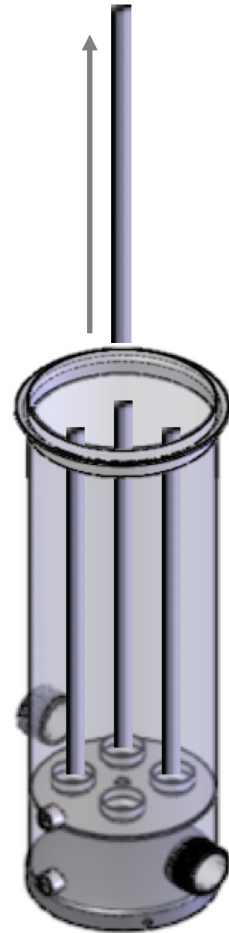

- 2) With gloves, remove 4 rods 20" in length from inside of unit and dispose

- Remove by making a circular motion pulling upwards
- Pliers may be required

- 3) Locate 4 stems that look like the rods that are approximately 4" long
- 4) Insert into the bottom of the filter
- 5) Insert the filter into the housing stem first

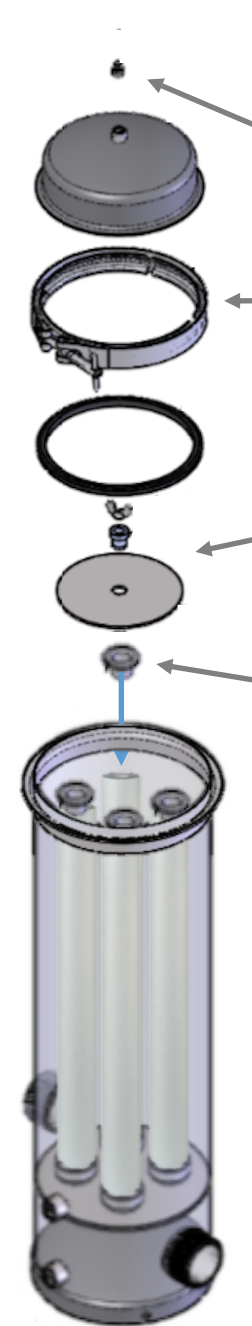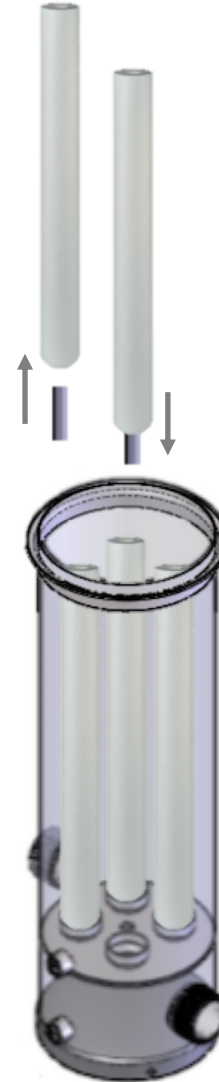

- 10) Unit is ready to place into service

- 9) Insert pressure relief if previously removed

- 8) Lubricate O-ring thoroughly and place the O-ring in the groove, locate the lid and strap and tighten the wing bolt until tightly secured

- 7) Place the holding plates over the filter group, insert the centering fitting and wing nut

- 6) Insert the 4 holding caps into the top of each filter

